



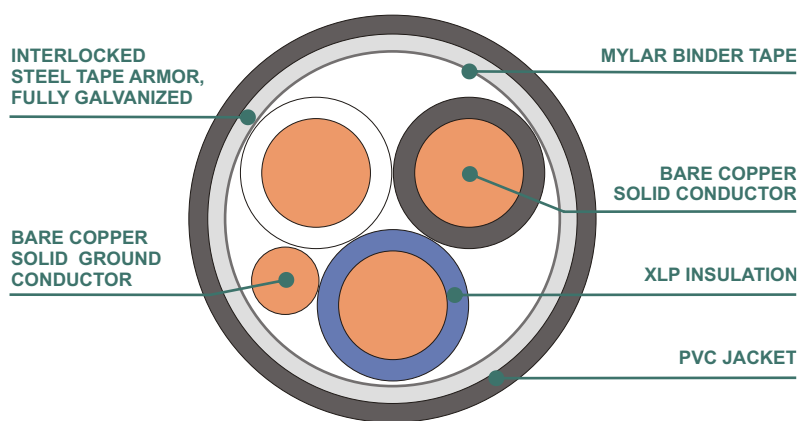

X90V AFTSI 194°F 2KV PUMP CABLE

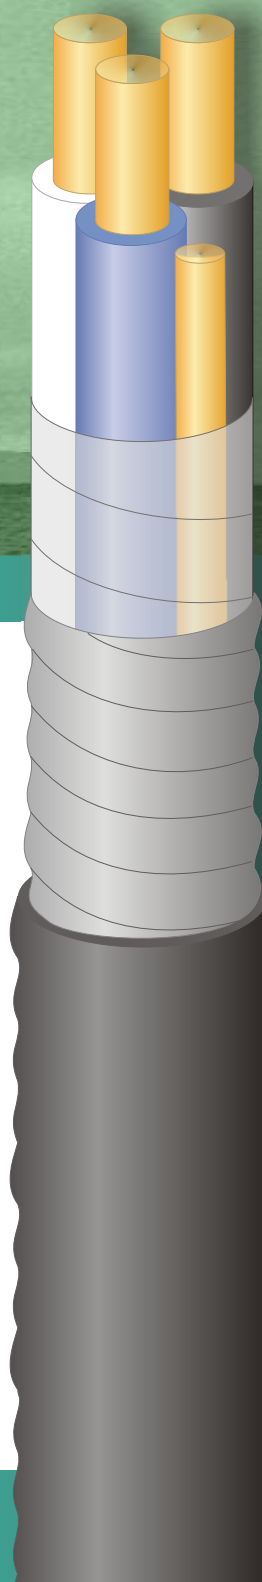

GAUGE (AWG)	MAXIMUM CONDUCTOR Ø (In)	INSULATION THICKNESS (mils)	MAXIMUM OVERALL Ø (In)
3x6+1x10	0.165 / 0.110	63	0.98
3x4+1x8	0.210 / 0.135	63	1.08

CONSTRUCTION

WWW.WIREX.COM.BR